

The New Interactive AWWA M11—Flange Bolt Torque Calculator—A Technical Guide to Its Background, Relevance, and Use

John H. Bambei Jr., P.E., M.ASCE¹; Elizabeth S. Ralph, P.E.²; David Lay³; and Brent D. Keil, P.E., M.ASCE⁴

¹Chair of AWWA Steel Pipe Committee; Owner, Bambei Engineering Services, LLC, 6781 West Woods Circle, Arvada, CO 80007. E-mail: john.bambej@gmail.com

²AWWA Staff Liaison to the Steel Pipe Committee; Staff Engineer, AWWA, 6666 West Quincy Ave., Denver, CO 80219. E-mail: lralph@awwa.org

³Member of SWPMTAC Pipe Group; Director of Training (Ret.), Hytorc, 9834 North 6180 West, Highland, UT 84003. E-mail: davidlay@hytorc.com

⁴Chair of SWPMTAC Pipe Group; Chief Engineer, Northwest Pipe Company, 5721 SE Columbia Way #200, Vancouver, WA 98661. E-mail: bkeil@nwpipe.com

ABSTRACT

The sequence of tightening bolts and controlling torque are very important to the assembly of flanged pipe joint connections. Among other factors, proper-flanged joint closure depends on applying the correct amount of gasket load and achieving uniform load around the joint. Since the load applied to the joint by the bolts is difficult to measure directly, torque is used as a convenient way to approximate the desired load. This paper will review torque calculations as they apply to ANSI/AWWA C207 flanges and the new AWWA web-based interactive tool, including examples for torque calculations as described in the recently published, *AWWA Manual M11, Steel Pipe—A Guide for Design and Installation, 5th Edition*.

BACKGROUND


The success of flanged joints depends on applying the correct amount of gasket load and achieving uniform load around the joint. ANSI/AWWA C207 (2018) states requirements for flange facing, gasket material, and bolting material. Flanges are to be flat faced, without projection or raised face with a serrated concentric or spiral finish with a resultant finish of 125- to 500- μ in. roughness. Gasket material may be either rubber, compressed fiber or PTFE (polytetrafluoroethylene). Bolting material shall be ASTM A193 grade B7 with ASTM A194 grade 2H heavy hex nuts for bolts larger than 1 in. and ASTM A 563 heavy hex nuts for bolts 1 in. and smaller.

GASKET LOAD

AWWA M11 (2017a) states that gaskets seal joints as they are compressed to fill imperfections and spaces in the flange faces. Insufficient compression can result in imperfections and spaces not being filled and can also result in insufficient resistance to hydrostatic pressure. Excessive compression can result in pinching or crushing of the gasket and consequently possible leakage. Desirable gasket load is generated by tightening the bolts in a controlled and uniform manner, usually to a given percent of their yield. By convention and design, most bolting of gasketed flanges is carried out to achieve a stress of approximately 50 percent of bolt material yield strength. The sum of all the bolt loads in the joint divided by the contact area of the gasket with the flanges equals the gasket stress.

BOLT LOAD

AWWA M11 (2017a) states that it is the bolt load that compresses the gasket and seals the joint. However, it is not just how tight the bolts are, but also how consistently they are loaded that ensures a proper seal. The intent is not just to achieve a sufficient load but also to minimize variations among the bolts. A complication to achieving uniform tightness is that bolts act like interactive springs in the joint. Tightening any one bolt will change the effective load of the nearby bolts. No matter how accurately torque or tension is initially applied to any single bolt, a subsequent retightening of all the bolts must be done to even out the load. A further complication is that although bolts react quickly and completely as loads shift during tightening, soft gasket materials do not exhibit similar resilience. Care must be taken to not overcompress the gasket because it may not spring back to fill the void if the load under any one bolt is reduced. That is the reason for gradually increasing the pressure in stages to the final load. In order to even out these loads, bolts are tightened in a specific sequence using gradually increasing passes or steps to achieve the final tightness.

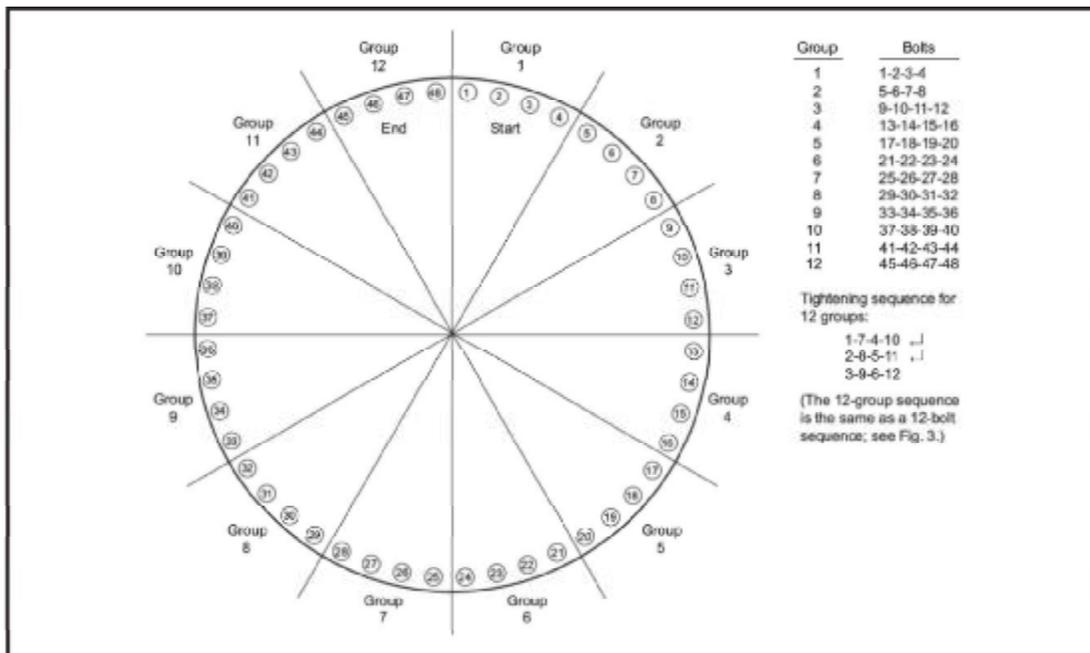

GENERAL NOTE: This figure is an illustration of how bolts may be grouped for tightening. Bolts may be grouped and tightened treating these groups as one bolt in the tightening sequence. A suggested number of bolts for a group is the number contained within a 30 deg. arc. However, potential gasket damage or flange misalignment should be considered when bolts are grouped.

Reprinted from ASME PCC-1-2010, by permission of The American Society of Mechanical Engineers. All rights reserved.

Figure A.1 Legacy Pattern—48-bolt flange bolt grouping example
Fig. 1 Bolt Tightening Pattern From ANSI/AWWA 604 (2017b)

ANSI/AWWA C604 (2017b) provides guidance on various tightening patterns that can be used. Fig. 1 is an example of one of these patterns. Whatever pattern is chosen, it should accomplish several interrelated goals to

- Apply sufficient bolt stress to maintain a leak-free connection
- Achieve uniform bolt stress and therefore uniform gasket stress around the flange

K = nut factor—how hard it is to turn, expressed as a decimal

D_s = nominal diameter of the stud, in.

F = load desired in the stud, lb

K is an empirical value related to the total resistance, derived experimentally by applying tightening torque to a bolt of a given nominal diameter in a scale device and observing the resultant load.

The screenshot shows the AWWA Flange Bolt Stress and Torque Analysis tool. It features a navigation bar with 'BACK TO RESOURCE COMMUNITY' and 'CONTACT US' buttons. The main content area is divided into several sections:

- Uses Instructions:** A list of seven steps for using the tool, including selecting input values, choosing flange class and diameter, entering seating face ID, selecting gasket style and material, inputting nut factor, clicking the CALCULATE button, and reviewing recommended ranges.
- Calculation Input Information:** A form with fields for 'AWWA C207 Flange Details' (Flange Class, Nominal Flange Diameter, Finished Flange Seating Face ID), 'Gasket Details' (Gasket Style, Gasket Material), and 'Nut Factor - Thermal Lubricant'. It also includes suggested nut factors for different lubricant types and a 'CALCULATE', 'PRINT', and 'RESET' button.
- Recommended Ranges:** A section for 'Target Torque' and 'Bolt Stress At Torque' with input fields for From, To, Stress, and % of Yield. It includes three numbered instructions for torque selection and the formula $T = \frac{K D_s F}{12}$.
- Calculation Data:** A section for 'AWWA C207 Flange Details' with fields for Number of Bolts, Bolt Diameter, Bolt Yield Strength, Flange Face ID, Flange OD, Bolt Circle Diameter, Gasket Seating Face Area, Bolt Cross Section Area, No Gasket Material, Seating Stress, Crushing Stress, Thermal Lubricant, Nut Factor, Bolt Yield Stress, Bolt Stress at Gasket Seating, % of Bolt Yield at Gasket Seating, Bolt Stress at Gasket Crushing, % of Bolt Stress at Gasket Crushing, Torque at Gasket Seating, and Torque at Gasket Crushing.
- Disclaimer:** A small text block at the bottom right stating that the authors, contributors, editors, and publisher do not assume responsibility for the validity of the content or any consequences of its use.

Fig 2. AWWA Interactive Torque Calculation Tool (2017c)

K is dependent on a number of factors such as temperature, quantity and application of lubricant to sliding surfaces, bolt diameter, thread pitch, fastener condition, and the applied load. Experience has shown the use of a nut factor to be for all intents and purposes as reliable and accurate as the more complex torque formula, and it can be relied on to produce acceptable results if consistently applied. Once determined, it is then applied generally to bolts of the same grade and diameter to relate torque to load. At normal assembly temperatures with standard bolts, the derivation of K can be simplified by adding 0.04 to the lubricant's coefficient of friction, μ (Bickford 1995). Coating or plating of bolts will also result in different friction conditions and therefore different torque requirements that for uncoated fasteners.

SUGGESTED VALUES FOR K

AWWA M11 (2017a) states that tests conducted by Brown et al. (2006) showed that average K values for a number of copper-, nickel-, molybdenum-, and graphite-based antiseize lubricants on standard ASTM A193 grade B7 studs were in a fairly consistent range from 0.16 to 0.18, regardless of assembly temperatures ranging from 23°F to 105°F. Consensus figures from multiple sources place the K value for petroleum-based lubricants such as SAE 20 oil at approximately 0.19 and for machine oil at approximately 0.21. Although dry alloy steel exhibit a rather wide scatter of values, a K value of 0.30 has been successfully used.

Testing by Cooper and Heartwell (2011) demonstrated that the presence of a through-hardened washer under the nut or bolt head has as great a positive effect on reducing overall friction as the use of a lubricant. The conclusion being that a hardened washer should be used under all turning nuts both to reduce required torque and also to improve consistency of load among the bolts.

TORQUE CALCULATIONS:

The recently published, AWWA Manual M11, Steel Pipe-A Guide for Design and Installation, 5th Edition (2017a) included a reference to an AWWA web-based interactive tool to do the torque calculations based on user input. The interactive tool can be found at www.awwa.org/TorqueCalc. A screen shot view is shown in Fig. 2.

The Torque Calculation Tool includes the following User Instructions:

1. Select or enter Calculation Input values in each of the red highlighted fields
2. Select “Flange Class” and “Nominal Flange Diameter”
3. If the finished flange face ID is known, enter it in the Finished Seating Face ID box. Otherwise leave the box blank (ID assumed for the calculation is shown in the Calculation Data)
4. Select “Gasket Style” and “Gasket Material”
5. Input nut factor (based on lubricant friction factor)
6. Once all red highlighted fields are filled out, select the CALCULATE button
7. Review guidance found in the “Recommended Ranges”

The user is able to select from ANSI/AWWA C207 (2013b) flange classes, gasket materials, and flange diameters. Based on the users input, the torque calculator generates a recommended torque range to select the appropriate torque value for the application. It also offers warning to the user if they have a potential of either crushing the gasket with too high of a load or not getting enough load to seat the gasket with their selected inputs.

CONCLUSION

A successful flange installation requires the proper amount of load applied to the gasket. The conventional way to achieve that load is by applying a measured torque to the flange bolts. The recently published, AWWA Manual M11 includes a description of calculating torque values for bolting ANSI/AWWA C207 flanges including the addition of a web-based, interactive tool for completing the torque calculation. The interactive tool provides users a way to easily determine an appropriate torque for their AWWA C207 flange installation.

REFERENCES

- ASME (The American Society of Mechanical Engineers). (2013a) Guidelines for Pressure Boundary Bolted Flange Joint Assembly, ASME PCC-1-2013, ASME, New York, NY.
- AWWA (American Water Works Association). (2018) *Steel Pipe Flanges for Waterworks Service, Sizes 4 In. Through 144 In. (100 mm Through 3,600 mm)*, ANSI/AWWA C207-13. AWWA, Denver, CO.
- AWWA (American Water Works Association). (2017a) *Steel Pipe - A Guide for Design and Installation, AWWA Manual of Water Supply Practices M11. Fifth Edition*. AWWA, Denver, CO.
- AWWA (American Water Works Association). (2017b) *Installation of Buried Steel Water Pipe – 4 In. (100mm) and Larger*, ANSI/AWWA C604-17. Denver, CO.
- AWWA (American Water Works Association). (2017c) “AWWA Interactive Torque Calculation Tool”, <http://www.AWWA.org/TorqueCalcs>. AWWA, Denver, CO.
- Bickford, J. H. (1995). *An Introduction to the Design and Behavior of Bolted Joints*. Boca Raton, FL. CRC Press.
- Brown, W., L. Marchand, and T. LaFrance (2006). *Bolt Anti-Seize Performance in a Process Plant Environment*, New York, NY. ASME Pressure Vessel Research Council, PVP2006-ICPVT11-93072.
- Cooper, W., and T. Heartwell (2011). *Variables Affecting Nut Factors for Field Assembled Joints*. New York, NY. ASME Pressure Vessels and Piping Conference, PVP2011-57197.